


Note:

- 1 - Inlet of Water Tank
- 2 - By-pass piping of pump
- 3 - Non-return check valve
- 4 - Pump Inlet Ball Valve
- 5 - Water Pressure Booster Pump
- 6 - Pump Outlet Ball Valve
- 7 - Pump Inlet / Water Tank Outlet

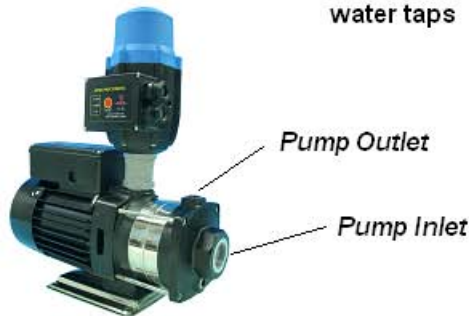

IMPORTANT:

- A. Allocate straight piping with distance of at least 15~30cm between immediately after Water Tank Outlet & Pump Inlet. DO NOT install any elbow fittings/ bending of water pipe at this location. (Refer Part No. 7)
- B. Pump Inlet piping diameter size must be in according to the pump connection and DO NOT reduce to smaller diameter, e.g. 1-1/4" for Maxflow075's Inlet. (Refer Part No. 4)